

SPACE AND DIMENSIONAL REQUIREMENTS

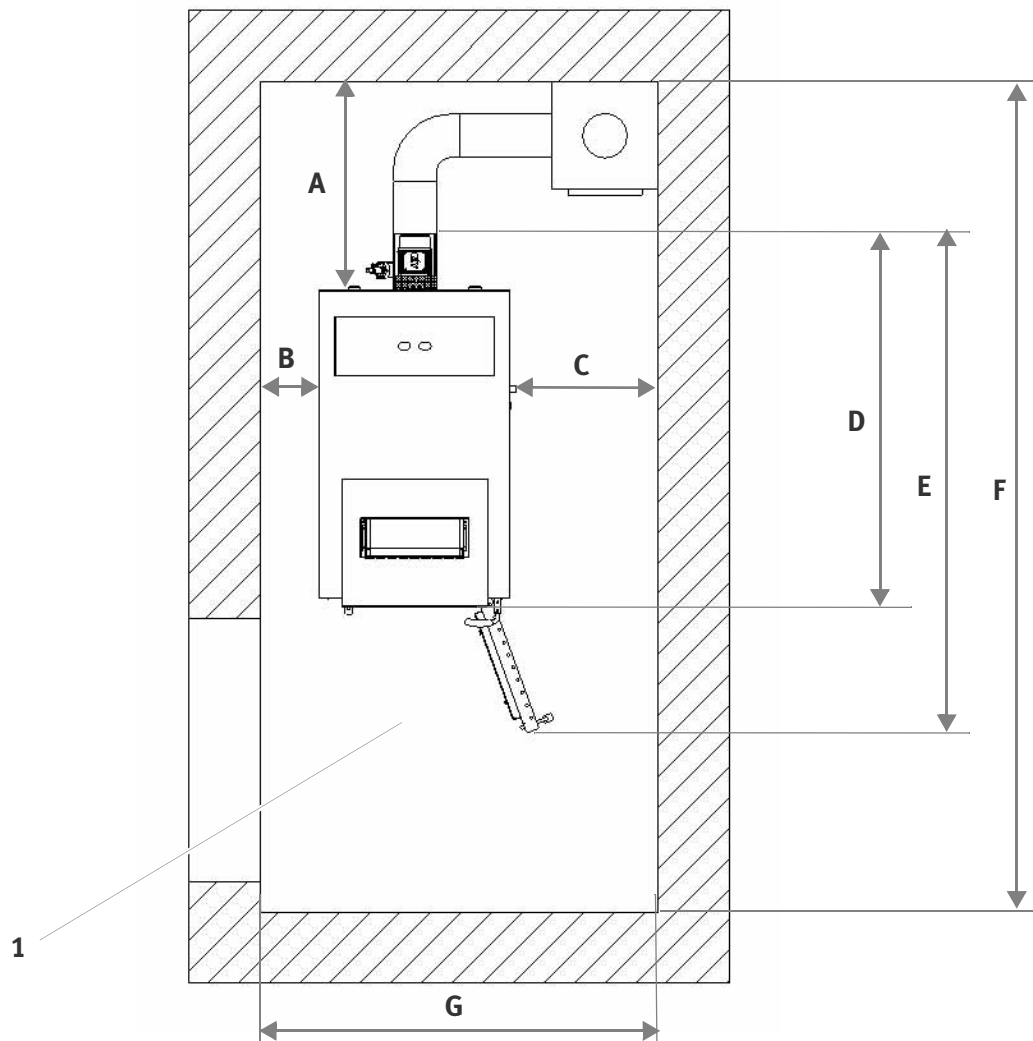


Figure 3/6 - Space and dimensional requirements

1 Boiler room

A) Min. 300 mm

B) Min. 200 mm (or 800 mm)

C) Min. 800 mm (or 200 mm)- One side must have at least 800 mm to allow access for cleaning.

D) 1.300 mm - One side must have at least 800 mm to allow access for cleaning.

E) 1700 mm

F) Min. 2.800 mm

G) Min. 1.350 mm

ROOM HEIGHT

Minimum required room height 1.950 mm, recommended 2.300 mm.

REQUIRED FOR INSTALLATION

Clearance dimensions: .1600 mm x 700 mm